



Application Data Sheet Thermal Differential Switch

PO Box 470426 • Tulsa, OK 74147
Phone: (918) 663-4406
Fax: (918) 663-4480
info@kenco-eng.com

1. Company: _____ Contact: _____ Title: _____
 Street: _____ City: _____ State: ____ Zip Code: _____
 Country: _____ Phone #: _____ Fax #: _____
 E-Mail: _____ # of Units: _____ Expected Delivery: _____

2. Process Media(s): _____

3. Temperature: *Process*: ____ °F max; ____ °F min *Ambient*: ____ °F max; ____ °F min

4. Pressure: _____ (psig) max; _____ (psig) min

5. Switch Type: Level Flow

6. Flow Rate – (Flow Switch) (GPM) : _____
or (FPS): _____

7. Pipe Size/Schedule – (Flow Switch): _____

8. Input Power: 110Vac 220Vac 24Vdc
 24Vac

9. Sensor Material: 316L SS 304 SS 304L SS
 Monel Hastelloy-C
 Alloy-20 Hastelloy-B
 Inconel 600


10. Process Connection: _____
(size and type)

11. Protection Method: Explosion-proof
 None

12. Agency Approval Required: Yes / No
(circle one)

13. Mounting: Integral / Remote;
If Remote, how far: _____ ft.

14. Sensor Length: _____

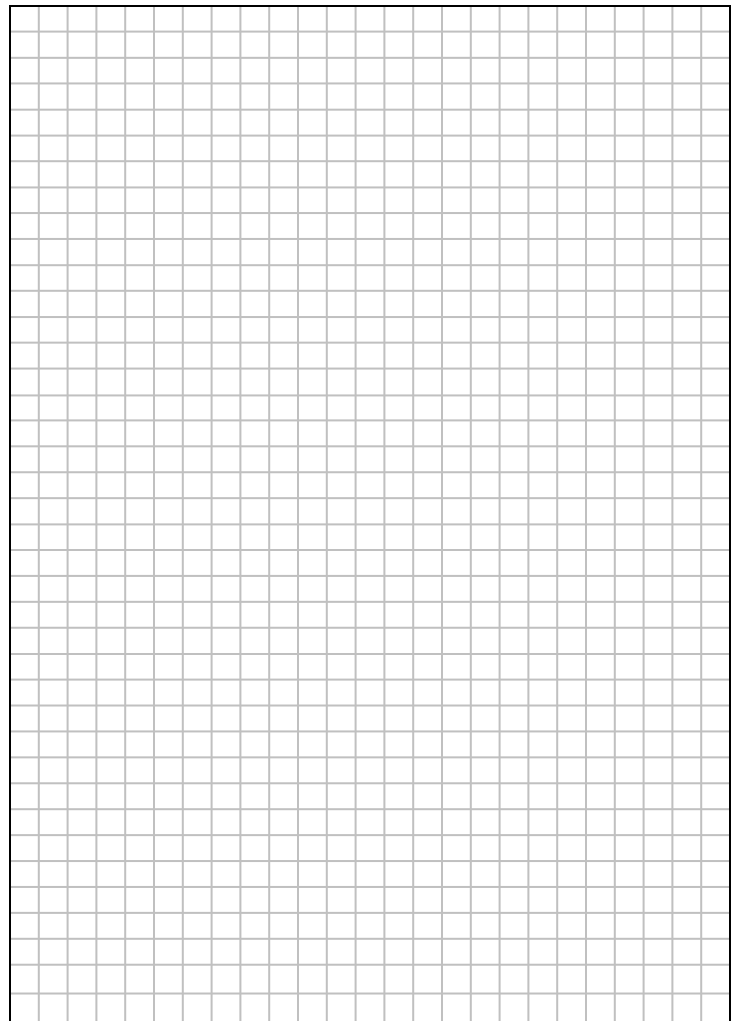

Provide a sketch of the installation if there are any obstructions which may interfere with the switch.